



FIRST CO.
P.O. BOX 270969 - DALLAS, TEXAS 75227
PH. (214) 388-5751 | FAX (214) 388-2255
WWW.FIRSTCO.COM

HydroTech™

R-410A Water Source Heat Pump

WSV6 Series

WATER SOURCE HEAT PUMP

Vertical - R-410A

7.5 thru 10 Tons

16+ EER



WSV6 Series

WATER SOURCE HEAT PUMP

HydroTech[™]
R-410A Water Source Heat Pump

The Hydro-Tech includes many standard features found only in higher priced products, plus a number of unique features, including:

- **Optional Vacated Premises Control (VPC) kit with reset feature:**
Ensures that the unit will operate a minimum of one or two hours per day during extended periods of unoccupancy. This option also includes an automatic reset feature. If a fault occurs, the system will shut down, but then automatically reset every 24 hours. If the same fault exists each day, the unit will lockout on the fourth day and have to be manually reset.
- **Superior insulation:** Fully insulated with 1" Fiberglass Insulation with FSK which is a flame retardant, vapor barrier facing. Improves overall efficiency and condensation control.
- **Removable discharge flange:**
Provides additional installation clearance.
- **Filter rack:** Standard Filter rack can hold 1" or 2" filters. Optional 4" filter rack available with 2" or 4" filters.
Optional 6" filter rack available with 2" and 4" filters.
- **State-of-the-art Digital Control Module (see p. 2).**



WSV6 Series

WATER SOURCE HEAT PUMP



ADDITIONAL STANDARD FEATURES

- 100% Factory Tested!
- R-410A Refrigerant - All units operate with environmentally friendly R-410A refrigerant.
- Stainless Steel Condensate Pan- Sloped for positive drainage
- High and Low pressure Service Ports
- Refrigerant Filter-drier
- Panel-mounted FPT Water Connections - No back-up wrench needed.
- Removable Panels for Service
- 75 VA Transformer
- 1" Throwaway Filter
- Disconnect switch and phase monitor

OPTIONAL FEATURES

- Cupronickel Coaxial Heat Exchanger
- Vacated Premises Control
- E-Coated Air Coil Corrosion Protection
- Evaporator Temperature Sensor

DEFINITIONS

Abbreviations and Definitions

CFM	= airflow, cubic feet per minute	EER	= Energy Efficient Ratio
EWT	= entering water temperature, °F		= Btu/h output/Watt input
GPM	= water flow in gallons per minute	COP	= Coefficient of Performance
WPD	= water pressure drop, psi and feet of water		= Btu/h output/Btu/h input
EAT	= entering air temperature, °F (dry bulb/wet bulb)	LWT	= leaving water temperature, °F
HC	= air heating capacity, MBtu/h	LAT	= leaving air temperature, °F
TC	= total cooling capacity, MBtu/h	TH	= total heating capacity, MBtu/h
HR	= total heat of rejection, MBtu/h	LC	= latent cooling capacity, MBtu/h
HE	= total heat of extraction, MBtu/h	S/T	= sensible to total cooling ratio
HGRH	= hot gas reheat		

WSV6 Series

WATER SOURCE HEAT PUMP




DIGITAL CONTROL MODULE

Controls unit operation and monitors all safety controls. (Patent Pending)

STANDARD FEATURES

- Digital Diagnostic Display - A two-digit display indicates either the current operational mode or a fault code
- 24V Status LED - Green light indicates 24V power to the control module
- VPC (Vacated Premises Control) - Allows the unit to operate for either 1 or 2 hours per day (total) during extended periods of unoccupancy (requires optional kit).
- Nuisance Trip Protection - Unit will attempt to start up to three times with a fault signal. If the fault continues, the unit locks out.
- Condensate Overflow Lockout
- High and Low Pressure Controls
- Water Coil Low Temperature Protection
- Over / Under Voltage Protection
- Random Re-start Timer
- Anti-short Cycle Timer
- Test Mode With LED Indicator - Speeds up control timers for service personnel
- Alarm Relay - Activated if the unit locks out
- Conformal Coating (both sides) for humidity and condensation protection

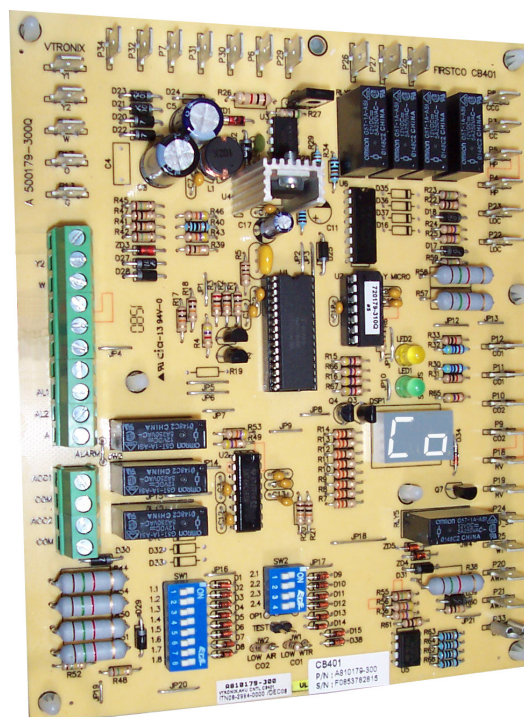

Electronic Control Module



WSV6 Series

WATER SOURCE HEAT PUMP

HydroTech
R-410A Water Source Heat Pump



DESCRIPTION OF OPERATION	LED Readout
NORMAL MODE	ON (Green Light)
CONTROLLER NON-FUNCTIONAL	OFF (Green Light)
TEST MODE (pins shorted momentarily)	ON (Yellow Light)
STANDBY	St
FAN ONLY (G active)	Fo
COOL (Y1 & O active)	Co
HEAT 1st Stage (Y1 active)	H1
ACCESSORY RELAY 1	A1
ACCESSORY RELAY 2	A2
VACATED PREMISES CONTROL	Vp
FAULTY RETRY	RE & CODE #
LOCKOUT	Lo & Code #
OVER / UNDER VOLTAGE SHUTDOWN	Ov & Code #
TEMPERATURE SENSOR ERROR	SE & CODE #
TEST MODE - NO FAULT	CODE 11
TEST MODE - HP FAULT	CODE 12
TEST MODE - LP FAULT	CODE 13
TEST MODE - CO1 FAULT	CODE 14
TEST MODE - CO2 FAULT	CODE 15
TEST MODE - COND. OVERFLOW FAULT	CODE 16
TEST MODE - OVER/UNDER SHUTDOWN	CODE 17
TEST MODE - SWAPPED CO1/CO2 THERMISTORS	CODE 18
TEST MODE - TEMPERATURE SENSOR ERROR	CODE 19

Sight Glass on Door



Optional Vacated Premises Selector
Switch
(Kit# 9WS01)

DIP SWITCHES (FIELD SELECTABLE SETTINGS):

- 5 Second Compressor Delay - Blower starts before the compressor, which helps attenuate compressor start up sound.
- 45 Second Blower-off Delay - Increases cooling efficiency.
- Continuous Dehumidification Mode - Selects continuous low speed fan operation for increased humidity removal.
- VPC Switch - Selects either one or two hour daily operation (requires optional kit)
- Lower Water and Air Coil Temperature Cutout Options - Optional 10 °F. Cutouts for applications where water temperature is below 50 °F. (Requires antifreeze solution).
- Two Accessory Relays - The relays can cycle with either the fan or compressor. In addition, relay number one can be configured for use with slow opening water valves (60 second pre-compressor initialization) and relay number 2 can be configured for a 30 second post fan delay.

WARNING AVERTISSEMENT ADVERTENCIA
Cancer and Reproductive Harm
Cancer et Troubles de l'appareil reproducteur
Cáncer y Daño Reproductivo

			PERFORMANCE DATA - CERTIFIED AT ARI/ISO 13256-1 CONDITIONS							
MODEL	NOM. CFM	GPM	WATER LOOP (entering Water Temperature)				GROUND WATER (entering Water Temperature)			
			86° Deg. F		68° Deg. F		59° Deg. F		50° Deg F	
			COOLING	EER	HEATING	COP	COOLING	EER	HEATING	COP
WSV6090	2680	25	93,000	16.1	92,000	4.75	101,000	22.00	73,000	4.1
WSV6120	3680	29	120,000	15.5	140,000	4.60	133,000	21.0	110,000	4.0

NOTE: **Certified at ARI/ISO 13256-1**

Tabulated performance data is at noted entering water temperature and entering air conditions of 80.6 degree DB / 66.2 degree WB at ARI / ISO 13256-1 rated 208V CFM.

NOTE:

Requires extended range temperature package

ELECTRICAL DATA							
MODEL NUMBER	VOLTAGE	COMPRESSOR		BLOWER		MIN. CIRCUIT AMPACITY	MAX. CIRCUIT PROTECTION
		RLA	LRA	FLA	HP		
WSV6090*E	208/230V-1-60	25.0	164	4.2	1.5	35.2	60
WSV6090*F	460V-3-60	12.8	100	1.9	1.5	17.9	30
WSV6090*M	208/230V-1-60	25.0	164	4.8	2.0 ¹	36.1	60
WSV6090*N	460V-3-60	12.8	100	2.3	2.0 ¹	18.3	30
WSV6120*E	208/230V-1-60	28.2	240	10.2	3.0	45.5	70
WSV6120*F	460V-3-60	14.7	130	4.8	3.0	40.1	60
WSV6120*M	208/230V-1-60	28.2	240	13.6	5.0 ¹	48.9	70
WSV6120*N	460V-3-60	14.7	130	6.3	5.0 ¹	41.6	60

¹ High Static Motor



AWSV6 BLOWER DATA														
MODEL NUMBER	FAN SPEED	MOTOR TERMINAL NO.	CFM vs EXTERNAL STATIC PRESSURE (inches of water)											
			0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2
WSV6090 1.5hp	HIGH STATIC	X1 + X2	---	---	---	---	---	---	---	2755	2670	2515	---	---
	MED.	X2	---	---	---	2900	2850	2800	2755	2705	---	---	---	---
	LOW	X1	---	2555	2300	1980	---	---	---	---	---	---	---	---
MODEL NUMBER	FAN SPEED	MOTOR TERMINAL NO.	CFM vs EXTERNAL STATIC PRESSURE (inches of water)											
			0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4
WSV6090 High Static 2.0hp	HIGH STATIC	X1-X2	---	---	---	---	---	---	---	3225	3185	3140	3085	3025
	MED.	X2	---	---	---	2965	2845	2745	2655	2585	---	---	---	---
	LOW	X1	2820	2535	2200	---	---	---	---	---	---	---	---	---

WSV6120 BLOWER DATA -BELT DRIVE											
AIR-FLOW (SCFM)	DESCRIPTION	ESP (in. wg)									
		0.2	0.4	0.6	0.8	1.0	1.2	1.4	1.6	1.8	2.0
3000	RPM	561	624	684	743	800	855	909	960	1010	1058
	BHP	0.7	0.8	0.9	1.0	1.2	1.3	1.5	1.6	1.8	2.0
	TURNS OPEN (±0.5)	5.0	3.5	3.0	4.0	2.0	4.0	2.5	1.0	3.5	2.0
3500	RPM	623	676	729	781	832	883	933	982	1031	1079
	BHP	0.9	1.0	1.2	1.4	1.5	1.7	1.8	2.0	2.2	2.3
	TURNS OPEN (±0.5)	4	3.5	2.0	2.5	1.0	3.5	2.0	4.0	2.5	1.5
4000	RPM	673	727	778	828	876	922	966	1007	1047	1085
	BHP	1.3	1.5	1.6	1.8	2.0	2.1	2.3	2.5	2.7	2.9
	TURNS OPEN (±0.5)	3.5	2.0	2.5	1.5	3.5	2.0	1.0	3.5	2.0	1.0
4500	RPM	732	784	833	881	926	969	1010	1049	1087	1121
	BHP	1.8	1.9	2.1	2.3	2.5	2.7	3.0	3.2	3.4	3.6
	TURNS OPEN (±0.5)	1.5	2.5	1.0	3.5	2.0	1.0	3.5	2.0	1.0	0.0
STANDARD MOTOR - 3 HP							OPTIONAL HIGH STATIC MOTOR - 5 HP				


--- NOTE: not recommended

NOTE:
Air flow data shown is with a dry coil at 70°DB EAT with Standard 1" filter


WSV6 Series

WATER SOURCE HEAT PUMP


HydroTech
R-410A Water Source Heat Pump

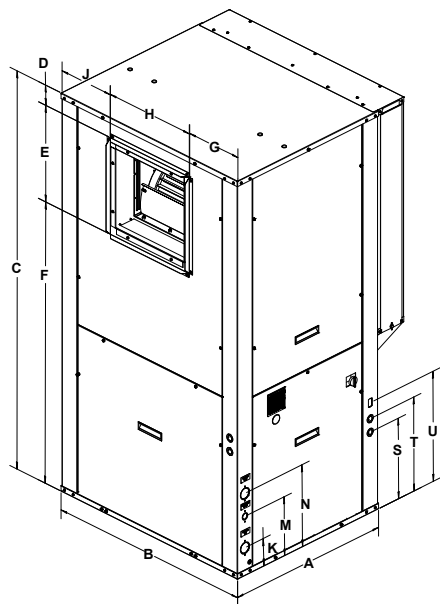

Straight Discharge
Right Hand Unit

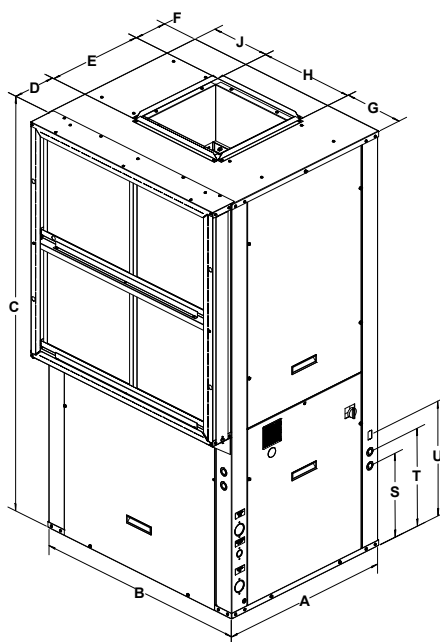

Top Discharge
Right Hand Unit

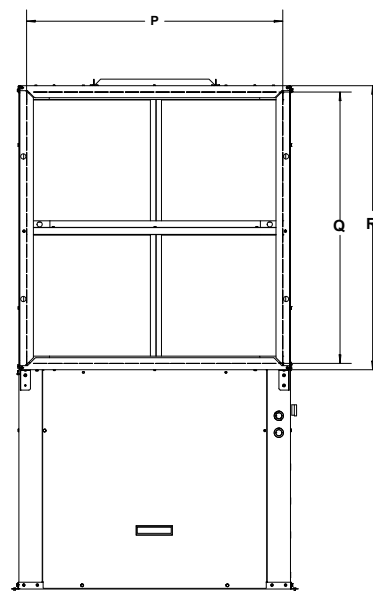

Side View (coil side)
Left Hand

DIMENSIONS																								
MODEL NUMBER	A	B	C	D	E	F	G	H	J	K	M	N	P	Q	R	S	T	U	V	W	Condenser Water Connections	Condensate Connections	Nom. Filter Size	Ship WT.
	Width	Depth	Height		Duct			Duct		Water In	Condensate Drain	Water Out	R/A Duct Flange Width	R/A Duct Flange Height	Filter Rack Height									
WSV6090 (Top)	32.0	40.0	74.1	8.1	18.0	6.2	11.2	18.0	11.2	5.1	10.9	15.2	39.9	39.7	41.8	15.0	17.5	20.5	20.0	32.3	3/4" FPT	1 1/2" FPT	20 x 20 x 1 qty 4	750
WSV6090 (Side)	32.0	40.0	74.1	3.9	18.0	52.4	11.2	18.0	11.2	5.1	10.9	15.2	39.9	39.7	41.8	15.0	17.5	20.5	20.0	32.3	3/4" FPT	1 1/2" FPT	20 x 20 x 1 qty 4	750
WSV6120 (Top Only)	32.0	48.0	74.1	6.5	20.8	4.9	13.9	20.8	13.6	4.8	10.8	16.3	47.8	39.8	41.8	14.9	17.4	28.9	19.9	32.3	3/4" FPT	1 1/2" FPT	20 x 24 x 1 qty 4	850

WSV6 Series

WATER SOURCE HEAT PUMP



MODEL NOMENCLATURE

<p>MODEL: WSV6 - 16 EER Vertical WSHP</p> <p>CAPACITY: 090 - 90,000 BTUH 120 - 120,000 BTUH</p> <p>REVISION LEVEL: A, B, C...</p> <p>VOLTAGE DESIGNATION: 2 - 208-240/1/60 PSC 3 - 265/1/60 PSC 6 - 208-230/1/60 CTM 7 - 265/1/60 CTM E - 208-230/3/60 STD. F - 460/3/60 STD. M - 208-230/3/60 HIGH STATIC N - 460/3/60 HIGH STATIC</p> <p>RETURN AIR LOCATION: L - LEFT HAND R - RIGHT HAND</p> <p>HEAT EXCHANGER: C - COPPER N - CUPRONICKEL</p> <p>WATER CONNECTION LOCATION: F - FRONT</p> <p>AIR SUPPLY LOCATION: T - Top S - Side</p> <p>FILTER FRAME: 1 - 1" filter frame (standard) 2 - 2" filter frame 4 - 4" filter frame 6- 2" + 4" filter frame</p>	<p>FUTURE OPTIONS:</p> <p>SPECIAL OPTIONS: 00 - No Options</p> <p>CABINET / SOUND OPTIONS: 0 - Std. Insulation A - Close Cell Foam B - Foil Face Insulation C - Sound Kit Option D - Sound Kit + Foil Face E - Extended Range F - Extended Range + Sound Kit G - Extended Range + Sound Kit + Foil Face</p> <p>REFRIGERANT / DEHUM OPTIONS: 0 - None H - Hot Gas Reheat B - Hot Gas Bypass C - Hot Gas Reheat and Hot Gas Bypass M - Modulating Hot Gas Reheat</p> <p>CONTROLS: 0 - Standard Without Disconnect A - Standard With Disconnect B - DDC (BacNet, Modbus) - w/Disconnect</p> <p>FILTER OPTIONS: 0 - 1" TA Standard A - 2" MERV 8 B - 2" MERV 11 C - 2" MERV 13 D - 4" MERV 11 E - 4" MERV 13 F - 4" MERV 14 G - 1" MERV 8 H - 1" MERV 11 J - 1" MERV 13 K - Permanent +4 MERV 11 L - Permanent +4 MERV 13 M - Permanent +4 MERV 14</p>
--	--

In keeping with its policy of continuous progress and product improvement, First Co. reserves the right to make changes without notice. Maintenance for all First Co. products is available under "Product Maintenance" at www.firstco.com.

WSV6090-WSV6120

Specification Guide

GENERAL

Equipment is completely assembled, piped, internally wired, fully charged with R410A refrigerant and factory tested. Filters, thermostat field interfaces, and all safety controls shall be factory installed.

Units shall be capable of operating over entering fluid temperature ranges of 50°- 110° in cooling mode and 50°- 90° in heating mode in standard configuration. The extended range option extends unit operating range to 20°- 120° in cooling mode and 20° - 90° in heating mode.

All equipment is tested and certified in accordance with (AHRI/ISO 13256-1) and comply with safety standards UL-1995 and CAN/CSA-C22./2. All units have AHRI/ISO and ETL labels.

UNIT CONSTRUCTION

CONFIGURATIONS

Vertical units are configurable in the following arrangements: left return/top supply, left return/side supply, right return/top supply, right return/side supply. For side discharge configurations, the supply side connection is on the opposite side of the unit finned tube heat exchanger.

For all systems, water, refrigerant and electrical connections are accessible from the front service access panel.

CABINET CONSTRUCTION

Units are built with a corner post and base design using a minimum of 18 gauge galvanized steel on any weight bearing component. Corner posts and panels are designed to allow for service access to all internal components. Structural integrity of the cabinets is unaffected by the removal of any or all of the access panels.

Air handling section interior surfaces are lined with 1" thick foil faced insulation. The insulation is placed such that there is no exposed section of the fiberglass fibers into the airstream.

The condensing section interior surfaces are lined with ½" of fiberglass insulation on the condensing section access panel and 1" thick insulation on the condensing section base pan, mid pan, and all lower access panels.

SERVICE CONNECTIONS

Water connections are accessible from the front of the unit. Water connections shall be made through factory installed brass FPT fittings which will be flush to the water panel. The water fittings shall be rigidly attached to the corner posts to forgo the use of a backup wrench when connecting the supply water.

SUPPLY AIR CONNECTIONS

Vertical systems have 1" integral supply duct collars to allow for connection of the supply duct. All duct collars are installed on the unit from the factory.

FILTER RACK

Vertical systems come standard with a 2" filter frame factory installed. The filter frame encloses the filter on all four sides to prevent air bypass around the filter. The filter frame provides tool-less access to the filters for replacement. The filter rack has integrated duct flanges for ducted applications. An option 4" filter frame may also be configured.

DRAIN PAN

All units use a stainless steel drain pan to increase corrosion resistance. The drain pan will be internally two-way sloped, with the drain port located near the front of the unit. The unit comes standard with an electronic condensate overflow sensor attached to the edge of the drain pan.

REFRIGERATION CIRCUIT

GENERAL

All systems use R410A refrigerant. All units have factory charged refrigeration circuits, each with its own compressor, reversing valve, bi-flow TXV, coaxial heat exchanger and finned tube refrigerant to air heat exchanger. Each circuit includes a high pressure switch, low pressure switch, and heat exchanger freeze sensors. The circuits each have a high-side and low-side Schrader valve to allow for service access to the refrigeration systems. All service ports are accessible from the front of the unit.

COMPRESSOR

All systems use a high efficiency scroll compressor. The scroll compressor is attached to a 12 gauge double-isolated compressor mounting plate to dampen vibration throughout the system.

For additional sound attenuation, an optional sound package is available which offers a compressor blanket.

COAXIAL HEAT EXCHANGER

The systems use one high efficiency coaxial heat exchanger. The coaxial heat exchanger is designed for working refrigerant pressures up to 600psi and working water pressures up to 400psi. The heat exchanger is coated in an epoxy resin to protect against corrosion.

Optional curpronickel coaxial heat exchangers are offered to provide additional corrosion resistance in certain hard water and open loop applications.

Specification Guide (Cont.)

REVERSING VALVE

A system reversing valve (4-way valve) is included with all heat pump systems. The valve is piped to be energized in cooling mode to provide heat if a valve failure were to occur. Once the valve is energized in cooling mode, it will remain energized as long as the O call is provided to the unit control board.

THERMOSTATIC EXPANSION VALVE

Each independent refrigeration circuit has its own balanced port, externally equalized bi-flow thermostatic expansion valve. The thermostatic expansion valve has sweat connections on the inlet/outlet and feature a screw on equalizer port connection.

EVAPORATOR COIL

Internally finned, 3/8-inch copper tubes mechanically bonded to a configured aluminum finned plate is standard. Coils are leak tested at the factory to ensure the pressure integrity. The coils are leak tested to 450 psig and pressure tested to 650 psig. The tubes are completely evacuated of air and correctly charged with proper volume of refrigerant prior to shipment. The refrigerant coil distributor assembly is of orifice style with round copper distributor tubes. The tubes are sized consistently with the capacity of the coil. Suction header is fabricated from rounded copper pipe.

FAN BLOWER

System includes either a forward curve direct drive fan with ECM motor or a belt driven forward curve fan with premium duty motor. The standard fan blower assemblies are designed to supply a nominal 400 CFM/ton at maximum of 1.5" of external static. Ratings for the fan blowers are done with a dry coil and with a standard 1" Merv 5 filter.

Optional high static motors are available to provide additional static range up to 2" of external static pressure at nominal 400 CFM/ton.

REFRIGERANT OPTIONS

HGRH ON/OFF WITH PART LOAD

Units may be configured with an optional hot gas reheat to provide for additional space dehumidification. The HGRH circuit adds an additional reheat coil in the air stream, integral 3 way valve, 2 way solenoid valve, and check valve. For systems with multiple refrigeration circuits, only the primary circuit will have the HGRH circuit.

The reheat coil circuit will be controlled via the H terminal, which must be wired to an external humidistat to provide dehumidification call to enable hot gas reheat mode. The HGRH circuit provide two stages of dehumidification based on cooling demand. In full load, the 3-way valve will bypass all refrigerant flow into the reheat coil. In part load, the 3 way valve diverts refrigerant flow into both the coaxial heat exchanger and reheat coil to reduce the amount of heat added back into the air stream. When the call for dehumidification is removed, both the 3-way valve and 2 way solenoid valve will close to divert all refrigerant flow through the coaxial coil.

ELECTRICAL AND CONTROLS

GENERAL

All units have a control box mounted in the condensing section compartment which houses all necessary electrical components for unit operation. This control box serves as the location for wiring of the high voltage and low voltage circuits for unit operation.

The unit is controlled via 24V low voltage terminals, which connects to an external thermostat or controller which will control the heating and cooling provided by the unit.

The electrical control box contains the following components.

1. Compressor Contactors
2. Blower motor contactors
3. Control Board
4. Low Voltage Wiring Connections
5. High Voltage terminal block
6. 24V Transformer for low voltage control
7. Phase monitor
8. High Voltage Disconnect Switch
9. Ground Connection

Specification Guide (Cont.)

WATER SOURCE CONTROL MODULE

All units will come standard with a WSCM electromechanical module that will control unit operation and contain safety features to protect the compressors, coaxial heat exchangers and fin-tube heat exchangers. The board will contain the following features:

1. Two-stage cooling and two-stage heating control modes for optimal temperature and
2. Anti-short cycle protection
3. Random Start
4. High and Low Pressure Safeties
5. Water Coil Freeze Protection
6. Air-coil Freeze protection
7. Over/under voltage protection
8. Fault Retry
9. Lockout with soft and hard reset
10. Condensate overflow sensor
11. Diagnostic LED display
12. Test Mode
13. Alarm Relay
14. Accessory Relays
15. Option Delays